




Klix Coanda 301

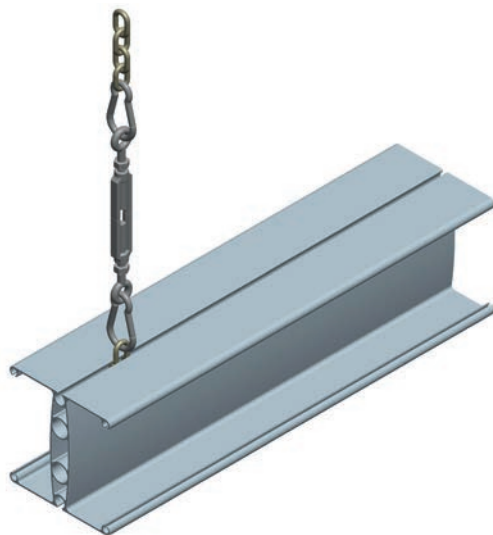

Klix Coanda 602

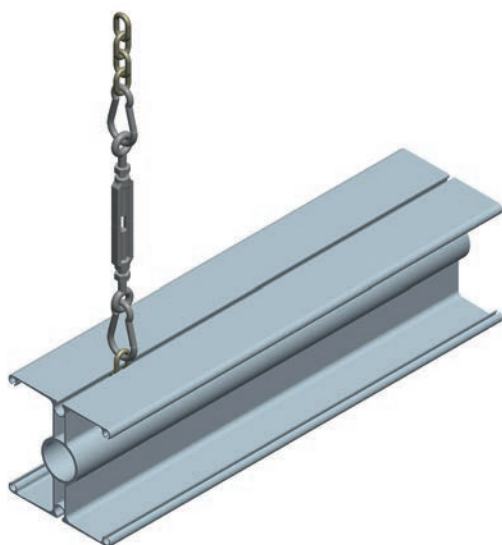

Klix Coanda 600

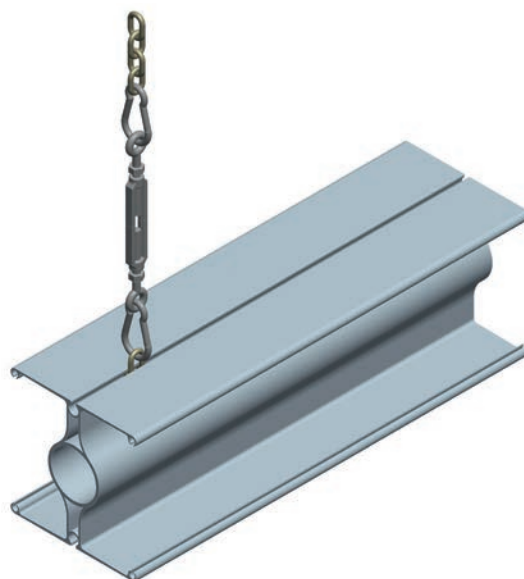

Klix Coanda 750  
Klix Helios 750

## Installation instructions for Klix Coanda radiant ceiling profiles



**Klix Coanda 301**  
**Klix Coanda 600**  
**Klix Coanda 602**  
**Klix Coanda 750**  
**Klix Helios 750**

Read the instructions thoroughly before installation/commissioning.  
After installation, leave the instructions for the end user.

## Klix Coanda suspension set




## Maximum load per mounting

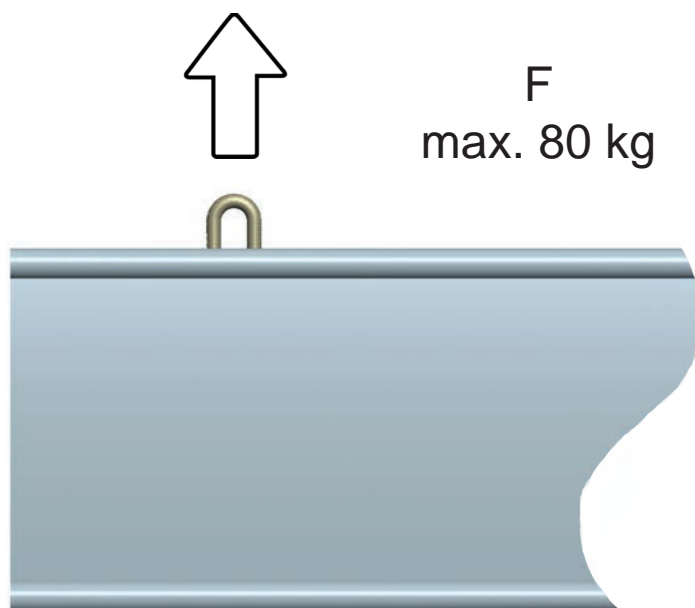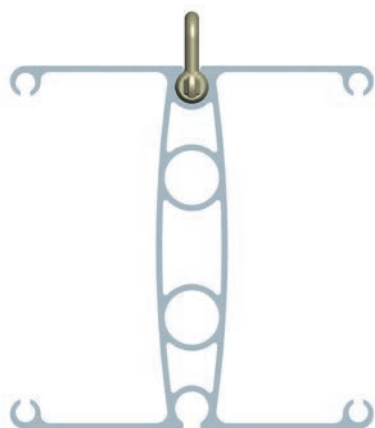


## max. distances of the mounting axes

X	Y
Y/2 (max. 1 m)	max. 3 m

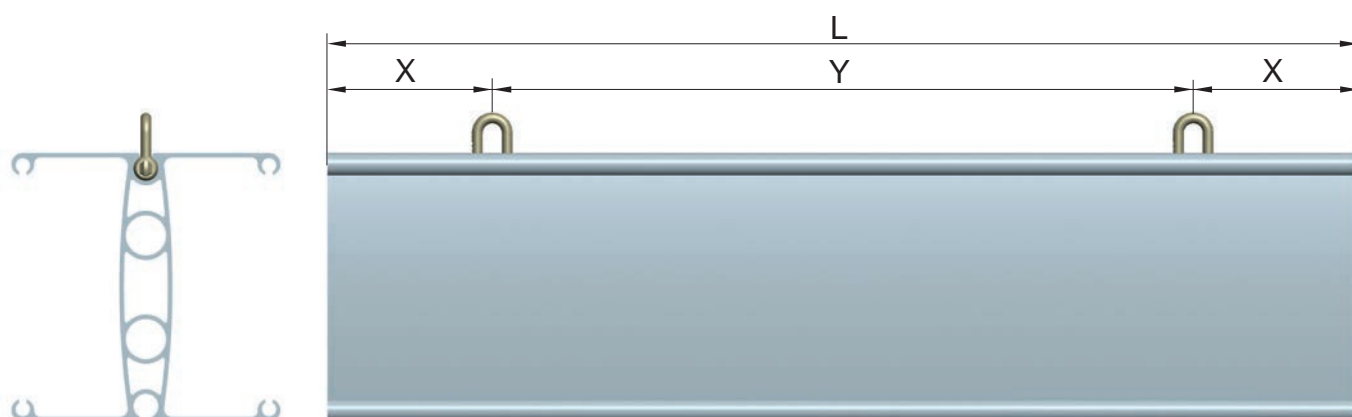


Length L	$\leq 5$ m	$\leq 8$ m	$\leq 11$ m	$\leq 12$ m
No. of mountings	2	3	4	5

## Mounting distances

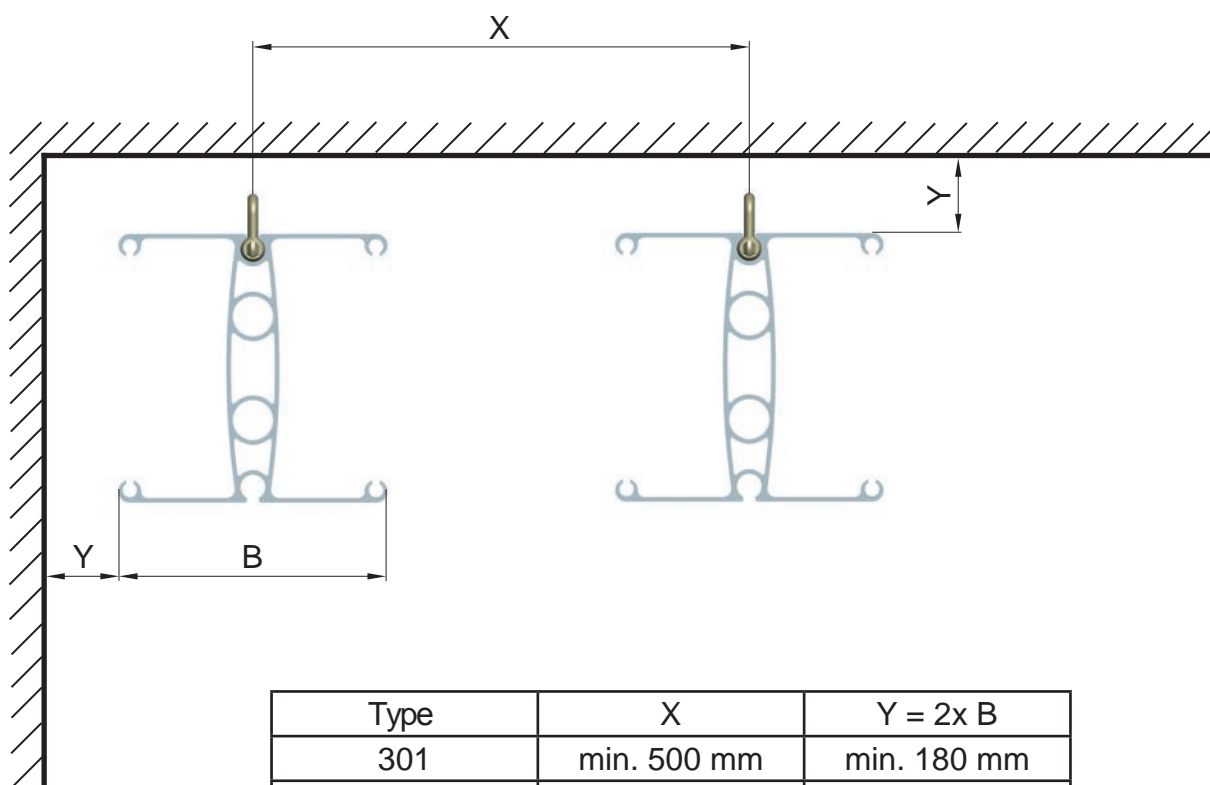

Type	X	$Y = 2 \times B$
301	min. 500 mm	min. 180 mm
600	min. 500 mm	min. 260 mm
602	min. 500 mm	min. 260 mm
750	min. 500 mm	min. 320 mm

## Mounting connector

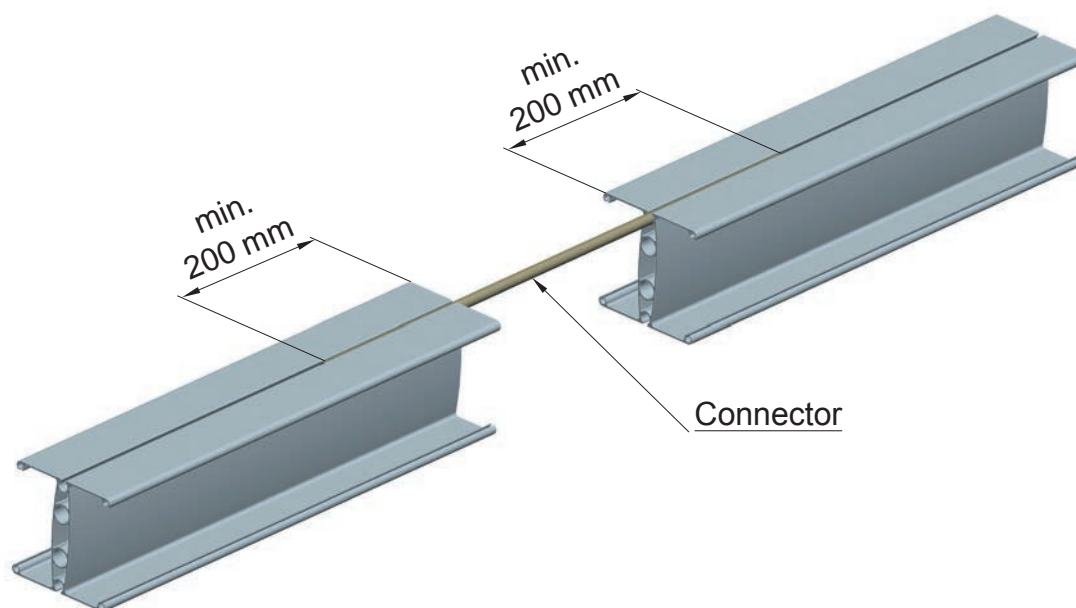

## Ceiling mounting kits

Only mounting sets approved by the manufacturer may be used for mounting the ceiling radiant heating profiles.

- Ceiling mounting kit for concrete ceiling
- Ceiling mounting kit for sectional steel
- Ceiling mounting kit for trapezoidal sheet metal
- Ceiling mounting kit for inclined steel beam
- Ceiling mounting kit for horizontal steel beam
- Ceiling mounting kit for wood

## Instructions for use

The radiant ceiling profiles may only be used for heating and cooling room air. Any other use is not in accordance with the intended use and is therefore not permitted.

The radiant ceiling profiles are not suitable for suspending objects or as climbing aids.

Ventilate the radiant ceiling profiles after commissioning and at regular intervals. Use only mild, non-abrasive cleaning agents.

In the event of a complaint, contact your specialist dealer or the supplier.

Have the installation and repairs carried out only by a specialist tradesman so that your warranty claims are not invalidated.

Dispose of used radiant ceiling profiles with accessories for recycling or proper disposal. Observe the local regulations.

## Installation instructions

Radiant ceiling profiles may only be installed by a specialist tradesman. Read the instructions thoroughly before installation/commissioning.

After installation, leave the instructions for the end user. Note the weight of the radiant ceiling profiles.

From 25 kg, use lifting device or work with several persons. Observe regulations for mounting components on ceilings. Only use radiant ceiling profiles in a closed system.

Avoid mixing materials (especially copper) in the installation.

Observe the necessary water quality due to the use of aluminium. Depending on the operating conditions, observe the dew point.

Check the system for leaks.

Check the mounting system on site and adapt it to the structural situation.

## Technical features


Medium: Water quality according to  
VDI 2035 SWKI BT 102-01  
ÖNORM H5195

Operating pressure: max. 5 bar  
Test pressure: 6,5 bar  
Operating temperature: 16°C-110°C



[www.allfest.de](http://www.allfest.de)  
e-mail: [info@allfest.de](mailto:info@allfest.de)

**KLIX**



Since 1989

Allfest Profilvertechnik GmbH  
Sulzbachstr. 69  
78554 Aldingen



Tel. +49 (0)7424 - 981 99 - 0  
Fax +49(0)7424 - 981 99 - 10